



# DIRIS A-10

Multifunction meters - PMD  
modular multifunction meter

Single-circuit metering,  
measurement &  
analysis



DIRIS A-10

diris\_978\_a\_front\_eps

## The solution for

- > Industry
- > Infrastructures
- > Tertiary



## Strong points

- > Easy to use
- > Integrated temperature sensor
- > Detects wiring errors
- > Compliant with IEC 61557-12

## Conformity to standards

- > IEC 61557-12
- > IEC 62053-22 class 0.5S
- > IEC 62053-23 class 2
- > UL



## Function

The **DIRIS A-10** is a modular multifunction meter for measuring electrical values in low voltage networks.

It allows all electrical parameters to be displayed and utilised for communication and/or output functions.

## Advantages

### Easy to use

Five direct access pushbuttons enable all measurements to be clearly viewed on its backlit LCD display.

### Integrated temperature sensor

It allows variations in temperature to be detected.


### Detects wiring errors

An integrated test function can be utilised to detect incorrect wiring and to automatically correct CT installation errors.

### Compliant with IEC 61557-12

IEC 61557-12 is a high-level standard for all PMDs (Performance Monitoring Devices) that are designed to measure and monitor electrical parameters in distribution networks. Compliance with IEC 61557-12 ensures a high level of equipment performance, in terms of metrology, and the mechanical and environmental aspects (EMC, temperature, etc.).

## Principle diagram

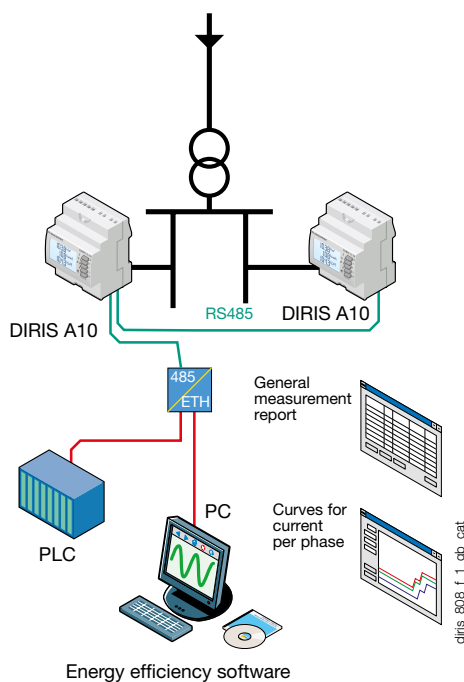

diris\_808\_L1\_gh\_cat

## Functions

### Multi-measurement

- Currents
  - instantaneous: I1, I2, I3, In
  - maximum average: I1, I2, I3, In
- Voltages & frequency
  - instantaneous: V1, V2, V3, U12, U23, U31, F
- Power
  - instantaneous: 3P, ΣP, 3Q, ΣQ, 3S, ΣS
  - maximum average: ΣP, ΣQ, ΣS
- Power factors
  - instantaneous: 3PF, ΣPF

### Metering

- Active energy: +/- kWh
- Reactive energy: +/- kVarh
- Hours: ⌚
- Harmonic analysis
  - Total harmonic distortion (level 51)
  - Currents: thd I1, thd I2, thd I3
  - Phase-to-neutral voltage: thd V1, thd V2, thd V3
  - Phase-to-phase voltage: thd U12, thd U23, thd U31

### Dual tariff function

Selection of one out of 2 billing tariffs

### Events

Alarms on all electrical values

### Communications<sup>(1)</sup>

RS485 with MODBUS protocol

### Input


- Tariff selection
- Remote device status

### Output

- Remote command of device
- Alarm report
- Pulse report


<sup>(1)</sup> Available on specific version (see the following pages).

## Front panel

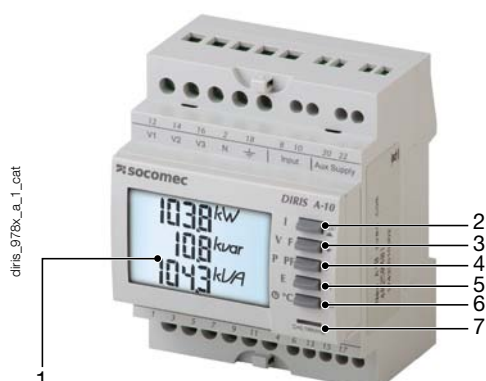

1. Backlit LCD display.
2. Direct access key for currents (instant and maximum), current THD and test function.
3. Direct access key for voltages, frequency and voltage THD.
4. Direct access key for active, reactive and apparent power (instantaneous and max. values) and power factor.
5. Direct access key for energies.
6. Pushbutton for hour meter, temperature and programming menu access.
7. Metrological LED.

## Case

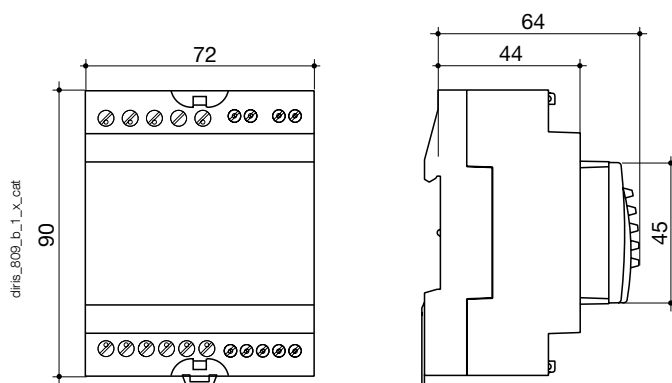

Type	modular
Number of modules	4
Dimensions W x H x D	72 x 90 x 64 mm
Case degree of protection	IP 30
Front degree of protection	IP 52
Display type	backlit LCD display
Voltage and current connection cross-section	4 mm <sup>2</sup>
Connection cross-section for AUX supply, input, output and comms.	2.5 mm <sup>2</sup>
Weight	205 g (4825 0010) - 215 g (4825 0011)

## Electrical characteristics

<b>Current measurement (TRMS)</b>	
Via CT primary	9 999 A
Via CT secondary	5 A
Measurement range	0 ... 11 kA
Input consumption	0.6 VA
Measurement updating period	1 s
Accuracy	0.2 %
Permanent overload	6 A
Intermittent overload	10 I <sub>n</sub> for 1 s
<b>Voltage measurements (TRMS)</b>	
Direct measurement between phases	50 ... 500 VAC
Direct measurement between phase and neutral	28 ... 289 VAC
Input consumption	≤ 0.1 VA
Measurement updating period	1 s
Accuracy	0.2 %
<b>Power measurement</b>	
Measurement updating period	1 s
Accuracy	0.5 %
<b>Power factor measurement</b>	
Measurement updating period	1 s
Accuracy	0.5 %
<b>Frequency measurement</b>	
Measurement range	45 ... 65 Hz
Measurement updating period	1 s
Accuracy	0.1 %

<b>Energy accuracy</b>	
Active (according to IEC 62053-22)	Class 0.5 S
Reactive (according to IEC 62053-23)	Class 2
<b>Auxiliary power supply</b>	
Alternating voltage	110 ... 277 VAC
AC tolerance	± 15 %
Frequency	50 / 60 Hz
Consumption	< 3 VA
<b>Digital output (pulses or on/off)</b>	
Number	1
Type	20 / 30 VDC - 0.5 A - 10 VA
Max. number of operations	≤ 10 <sup>9</sup>
<b>Input (tariff)</b>	
Number	1
Type	0 VAC: T1 / 200-277 VAC: T2
<b>Communication</b>	
Link	RS485
Type	2 ... 3 half duplex wires
Protocol	MODBUS RTU
MODBUS <sup>®</sup> speed	2400 ... 38400 bauds
<b>Operating conditions</b>	
Operating temperature	- 10 ... + 55 °C
Storage temperature	- 20 ... + 70 °C
Relative humidity	85 %

# DIRIS A-10

Multifunction meters - PMD  
modular multifunction meter


## Connection

### Recommendation:

- For IT earthing systems, it is recommended that the CT secondary is not connected to earth.
- When disconnecting the DIRIS, the secondary of each current transformer must be short-circuited. This operation can be carried out automatically by a SOCOMEC PTI, an accessory which is included in this catalogue. Please consult us.
- It is recommended that the earthing point for the DIRIS A-10 and the current transformer secondaries are not earthed at the same time.


### Low voltage balanced network

#### 3/4 wires with 1 CT

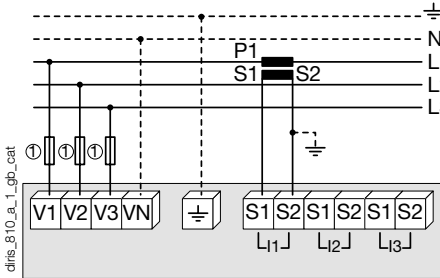


1. Fuses 0.5 A gG / 0.5 A class CC.

#### Single-phase

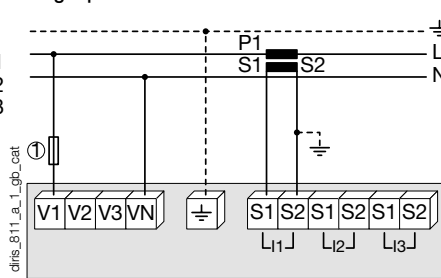

1. Fuses 0.5 A gG / 0.5 A class CC.


#### Two-phase

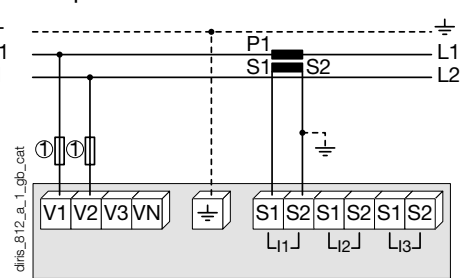

1. Fuses 0.5 A gG / 0.5 A class CC.


### Low voltage unbalanced network

#### 3/4 wires with 3 CTs

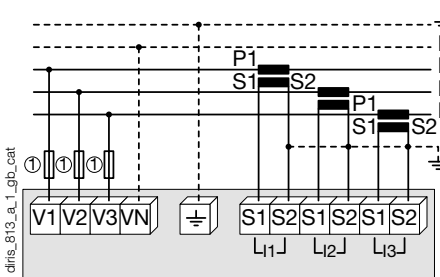


1. Fuses 0.5 A gG / 0.5 A class CC.

#### 3 wires with 2 CTs

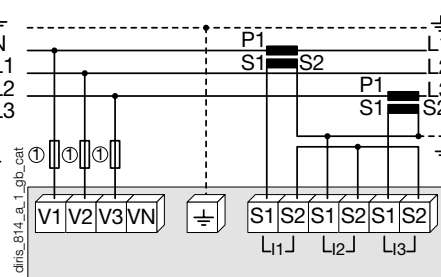

Use of 2 CTs reduces by 0.5% the accuracy of the phases, the current of which is worked out by vector calculation.  
1. Fuses 0.5 A gG / 0.5 A class CC.


#### 3 wires with 2 CTs

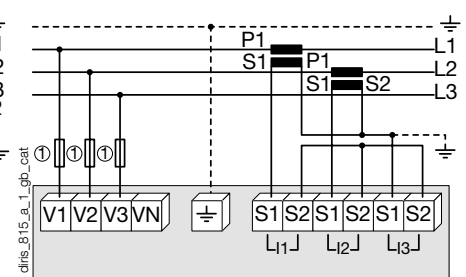

Use of 2 CTs reduces by 0.5% the accuracy of the phases, the current of which is worked out by vector calculation.  
1. Fuses 0.5 A gG / 0.5 A class CC.


## Additional information

### Communication via RS485 link

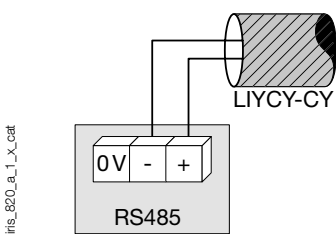

diris\_b20\_a\_1\_x\_cat


### AC auxiliary power supply



diris\_b21\_e\_1\_x\_cat

1. Fuses 0.5 A gG / 0.5 A class CC.


## Terminals

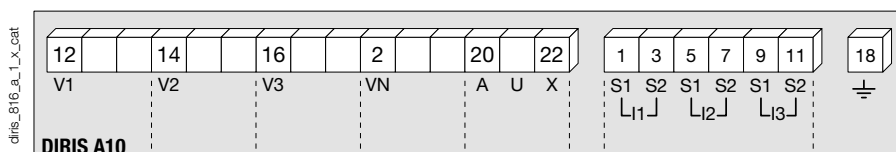

AUX: auxiliary power supply  $U_s$ .  
V1, V2, V3 & VN: voltage inputs.


S1 - S2: current inputs.

### Communication terminals




RS485 link.

### Pulse or alarm output terminals



4 - 6: output n°1

### Input terminals



8 - 10: input n°1

## References

Basic device		DIRIS A-10
<b>Description</b>		<b>Reference</b>
DIRIS A-10 (available in light grey on request)		4825 <b>0400</b>
DIRIS A-10 with RS485 MODBUS communication (available in light grey on request)		4825 <b>0401</b>
<b>Description of accessories</b>	<b>To be ordered in multiples of</b>	<b>Reference</b>
Fuse disconnect switches for the protection of voltage inputs (type RM) 3 poles	4	5601 <b>0018</b>
Fuse disconnect switches for the protection of the auxiliary supply (type RM) 1 pole + neutral	6	5601 <b>0017</b>
Fuses type gG 10x38 0.5 A	10	6012 <b>0000</b>
Current transformer range	1	488
Management software for DIRIS		464

## Expert Services

- > Study, definition, advice, implementation, maintenance and training... Our experts "Expert Services" offer complete support for the success of your project.

